


STANDARD RESIDENTIAL METER SET

NOTES

1. Same setup for 7" W.C. and 2 psig at outlet of meter
2. 2 psig customers piping must have "2psig" stickers on pipe every 6'
3. Customer piping may be no closer than 1'-0" from Authority's riser
4. Regulator cannot be installed under a window or within 3' of any ignition source
5. Distance from finished grade to center of valve shall be 6'
6. Customer piping must extend through wall 6", consist of rigid pipe or a nipple attached to tubing and fastened securely.

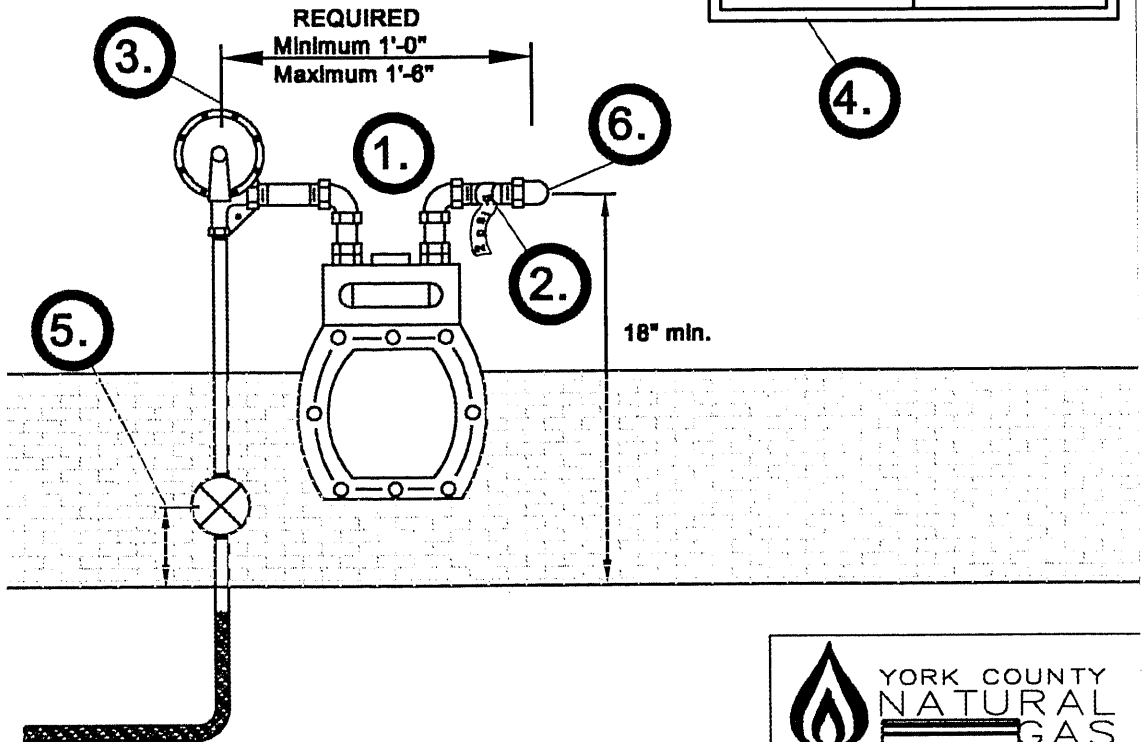

979 W. Main St. P.O. Box 11907
Rock Hill, SC 29731
Office: (803) 329-5255
Fax: (803) 327-2069
Emergency: (803) 329-2633